

MODEL 764T

PNEUMATIC TEMPERATURE CONTROLLERS

SECTION I

I. DESCRIPTION AND SCOPE

The Model 764T is a temperature controller with an integral, rigid insertion bulb used for sensing temperature, and outputting a pneumatic signal proportional to the deviation from the setpoint.

This IOM-764T does not cover use of oxygen as the "instrument air" fluid. Such an application is outside the scope of this IOM.

With proper materials and pipe sizes, the 764T can be used to measure the temperature of liquid, gaseous, or vapor service. The installation of the thermal bulb can be direct or indirect using a thermal well. Refer to Technical Bulletin 764T-TB for design and selection recommendations.

Abbreviations Utilized:

IAS - Instrument Air Supply
SIG - Signal
P/P - Pneumatic-to-Pneumatic
TC - Temperature Controller
TI - Temperature Indicator
SRV - Safety Relief Valve

ES - Electrical Supply
TC - Temperature Control valve
P1 - Inlet Pressure
P2 - Outlet Pressure
TR - Condensate Trap
PB - Proportional band

CW - Clockwise
CCW - Counter Clockwise
REV - Revolution or Reverse
DIR - Direct
FS - Flow Switch
SOV - Solenoid Valve

SECTION II

II. INSTALLATION

1. Location of the thermal bulb into the medium being controlled is critical.
 - a. Always insert the maximum bulb length into the medium.
 - b. Always locate the bulb at a point downstream of a heat exchanger to assure a near-equal distribution of the temperature across the containment cross-section.
 - c. Always locate the control valve doing the temperature control no further than 6-10 feet (2-3 meters) away from the controller when the control valve does not have a positioner.
 - d. Do not use a thermal well unless the Owner's process conditions, safety considerations or maintenance procedures require such; a thermal well enters an extra time response delay (i.e. reduction in sensitivity) to the closed loop.
 - e. If a thermal well is required, to maximize heat transfer efficiency, locate on the top of a pipe (vertical or at a 45° angle), duct, or at a 45°



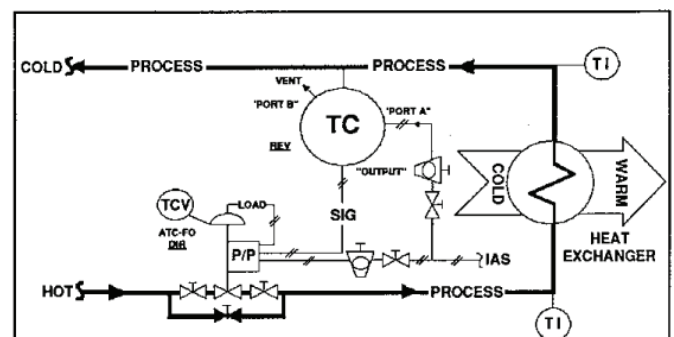


Figure 1: Typical Direct Cooling Application

angle to a vertical wall or horizontal top, when possible, to allow filling of "void space" in well with a suitable liquid heat transfer medium. (See Figure's 4 and 5).

- f. If a thermal well must be installed in a horizontal orientation, attempt to "pack" the "void space" with steel or SST wool at bulb insertion. Use of the well packing will increase thermal efficiency (reduce time constants) above that of a "dead air" space in the "void space"; i.e. dead air space acts as an "insulator" to heat transfer.

6. Use suitable pipe thread sealant when installing a thermal well or a 764T thermal bulb.

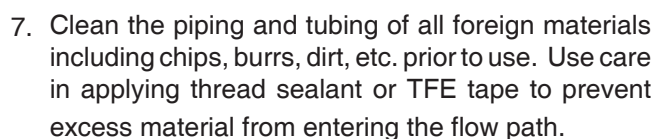

-

IOM- 764T

TABLE 1		
Controller	Model 764T	
ISA to Port	Action	
	Direct	Reverse
A	Exhaust	Supply
B	Supply	Exhaust
PROCESS TEMPERATURE	Increase in temperature <u>increases</u> output signal	Increase in temperature <u>decreases</u> output signal

11. Instrument air exposed to outdoor freezing temperatures must be desiccant dried. Refrigerated drying is not adequate.
12. Instrument air exposed to indoors and/or no-freezing temperatures is recommended to be refrigerant dried as a minimum.
13. If the air supply is at a remote location, and can not be practically dried and bears oil (i.e. plant air), coalescing filters must be utilized to remove as much oil and water as possible, as well as particles over 15 microns size.

TABLE 2			
Controller	"Heating Applications"		Controller Temperature Adjustment
IAS to Port	Actions		
	Control Valve	Controller	
A	ATO-FC (<u>Reverse</u>)	<u>Reverse</u> Increase in temperature decreases output signal. Valve "fails" to "cooler" process temperature.	CW = - temp CCW = + temp
B	ATC-FO (<u>Direct</u>)	<u>Direct</u> Increase in temperature increases output signal. Valve "fails" to "hotter" process temperature.	CW = + Temp CCW = - Temp
B	"Cooling" Applications		
	Actions		
	ATO-FC (<u>Reverse</u>)	<u>Direct</u> Decrease in temperature decreases output signal. Valve "fails" to "hotter" process temperature.	CW = + Temp CCW = - Temp
A	ATC-FO (<u>Direct</u>)	<u>Reverse</u> Decrease in temperature increases output signal. Valve "fails" to "cooler" process temperature.	CW = - temp CCW = + temp



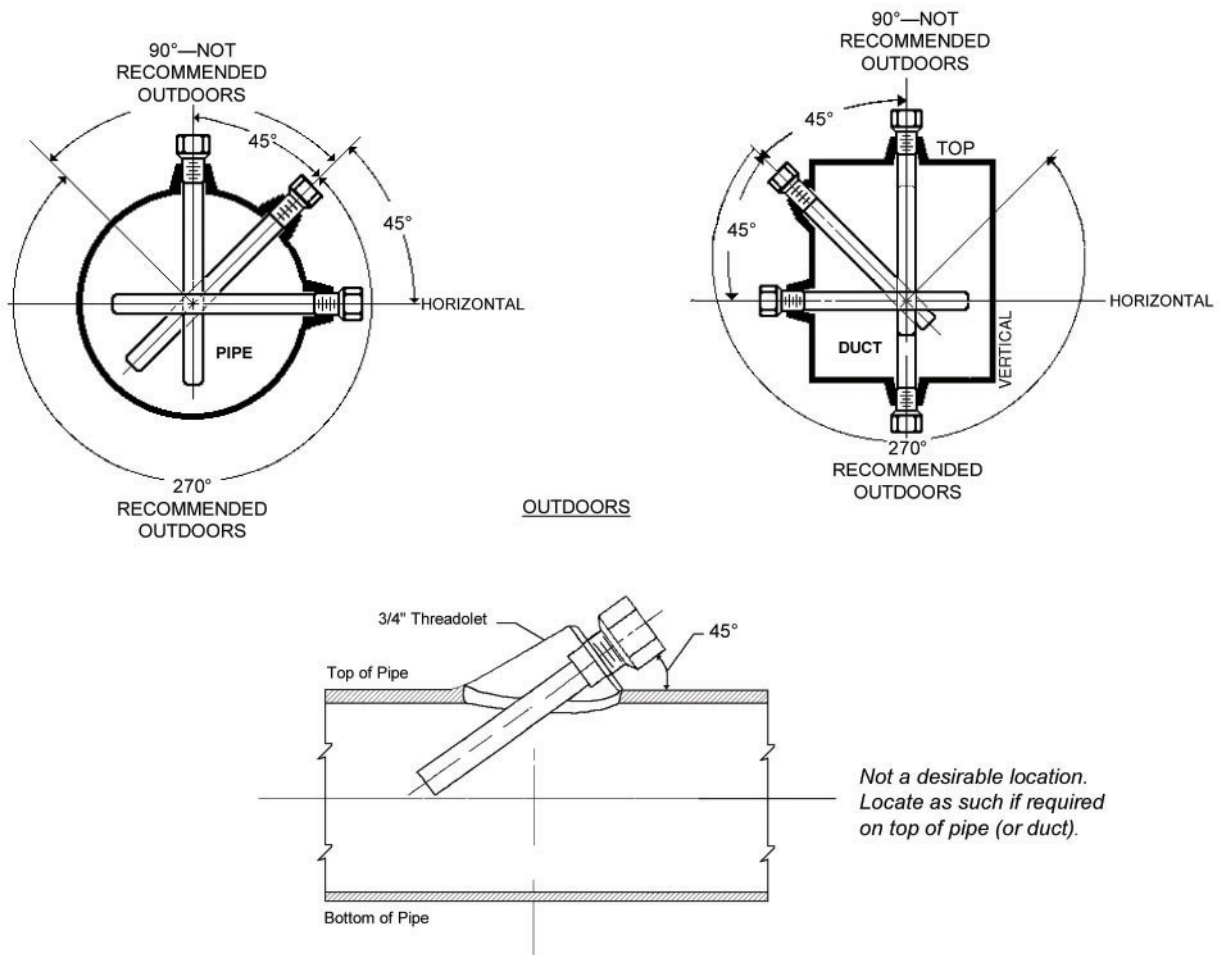


Figure 4: Recommended Thermal Well (Opt. 64) Installation

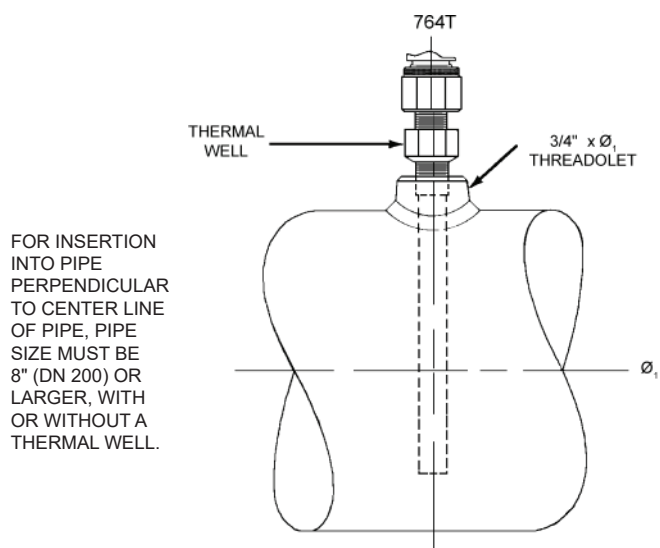


(a): Pipe 8" (DN 200) Ø & Larger

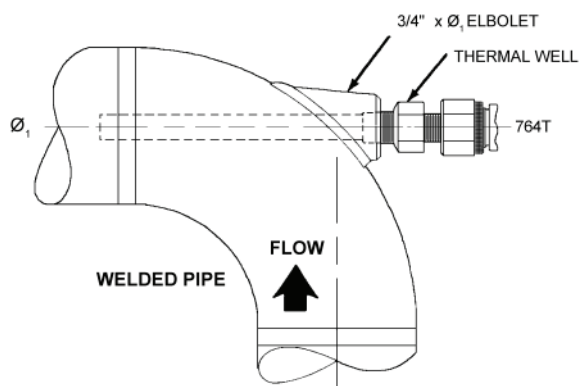

(b): Req'd: 2-1/2" (DN 65) Thru 6" (DN 150)
Optional: 8" (DN 200) or Larger

$\varnothing_1$		$\varnothing_2$		Nipple Length L_2	
Inch	(DN)	Inch	(DN)	Inch	(mm)
1/2"	15	1"	25	6"	(152)
3/4"	20	1-1/4"	32	6"	(152)
1"	25	1-1/4"	32	6"	(152)
1-1/4"	32	1-1/2"	40	6"	(152)
1-1/2"	40	2"	50	6"	(152)
2"	50	2"	50	NR	
2-1/2"	65	2-1/2"	65	NR	

NR = Not Required

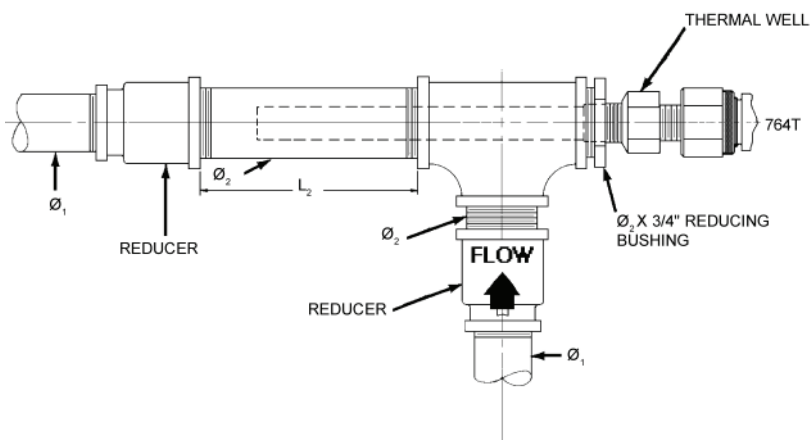

(c): Thru 2-1/2" (DN 65) Screwed Pipe Sizes.

Figure 5: Recommended Thermal Well (Opt. 64) Installation

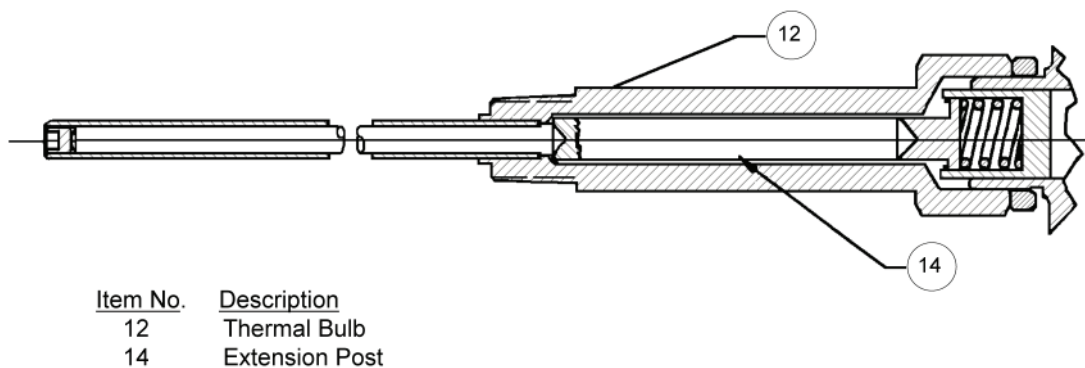


Figure 6: High Temperature Thermal Bulb (Opt. 63)

SECTION III

III. PRINCIPLE OF OPERATION

1. The 764T controller employs laminar flow to develop the 3-15 psig (nominal 0.2 - 1.0 Barg) output signal. Laminar flow was chosen because it eliminates the need for range springs, levers, pivots and other parts that produce friction and lost motion.
2. A bimetallic thermal bulb is used to measure temperature. It is immersed in the fluid whose temperature is to be controlled. A temperature variation changes the length of the outer tube more than it changes the length of the Invar rod. This difference produces a minute movement of the end of the Invar rod that contacts the sensor plate. The sensor plate, in turn, throttles the flow of instrument air through the sensor to develop the 3-15 psig (0.2 - 1.0 Barg) output signal.
3. On direct acting controllers, see Figure 7, the supply enters PORT B. With an increase in the

sensed temperature the supply air flowing through the sensor orifice increases, which elevates the output signal. The proportional band restriction regulates the flow of exhaust through PORT A.

4. On reverse acting controllers the supply enters PORT A and passes through the proportional band restriction. With an increase in the sensed temperature the flow through the sensor orifice is increased, which reduces the output signal. PORT B is the exhaust port.
5. Closing the proportional band adjusting screw reduces the proportional band. Opening the screw increases the proportional band.
6. The setpoint adjustment moves the sensor closer to, or further away from, the sensor plate to change the controlled temperature.

Direct Action: Rotate CW to increase temperature set point and CCW to decrease temperature set point.

Reverse Action: Rotate CW to decrease temperature set point and CCW to increase temperature set point.

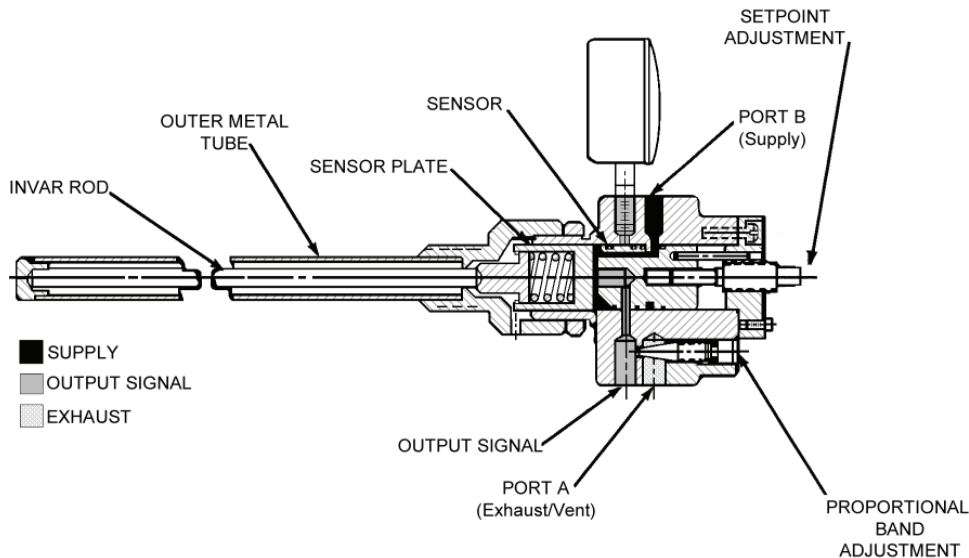


Figure 7: 764T Direct Action View Shows Port A & B Rotated From Actual Position

SECTION IV

IV. START-UP

1. Prior to pressurizing thru the airset, disconnect the IAS at the airset inlet, open the IAS block valve and air-blow the supply piping/tubing to clear of any debris, moisture, etc. Re-connect to the airset.
2. Disconnect IAS tubing at the 764T, open the IAS block valve at the airset and air-blow. Repeat for IAS to the positioner, if supplied.
3. Set airset to 18 psig (1.24 Barg) outlet pressure. Blow down the airset drip well.
4. Establish flow past the bulb, allowing the bulb to "sense" the actual temperature.
5. It is recommended that the control valve that receives the output SIG of the 764T be manually isolated at "cold" start-up. To prevent initial temperature overshoot/undershoot while the system reaches thermal stability, initiate flow in the control valve loop by manually bypassing.
6. Observe actual temperature of the fluid being temperature controlled utilizing a separate thermometer/instrument. As the control temperature approaches the "setpoint" temperature, begin to manually close the control valve bypass. Attempt to establish steady-state manual control. **NOTE:** *It may take a time frame of 15 minutes or greater to establish any level of steady-state manual control; DO NOT MOVE TOO FAST!*
7. Observe the action of the control valve in response to the action of the 764T temperature controller. Confirm that the proper combined "loop action" is occurring. If not correct, review the required action desired, and reverse action of either the control valve or 764T. To reverse action of a 764T, the IAS to the 764T must be removed from the "as installed" 764T port, and re-connect in reverse; i.e. if IAS was installed to Port "B", change to Port "A", and vice versa. (See Tables 1 and 2).

NOTE: The 764T is factory calibrated to approximately mid-range; i.e. a 50-220°F (10-104°C) temperature range will have setpoint at approximately 135°F (57°C). It is recommended that the unit be shop calibrated, if required. Field calibration is, in most cases, not practical. See Section VI.

8. Adjust setpoint by rotating the adjusting screw (2.3) until the desired temperature is indicated on the thermometer.

NOTE: The PB and setpoint adjustments are "interacting", meaning that to change one will likely cause the other to have to be changed. With each of these adjustments, the temperature indicated on the thermometer and the amount of rotation of the adjusting screw (2.3) may be growing apart, although the actual setpoint may not be changing. If this setpoint deviation is objectionable, determine the deviation after all the adjustments have been completed on the 764T.

NOTE: The 764T is shipped with the proportional band (PB) set at a minimum value of approximately 3%. Matchmarks are factory placed on the housing (1) and needle valve (3) head corresponding to the 3% PB value.



CAUTION

Do not rotate the needle valve (3) CW below the 3% PB value, as the unit will be rendered inoperative.

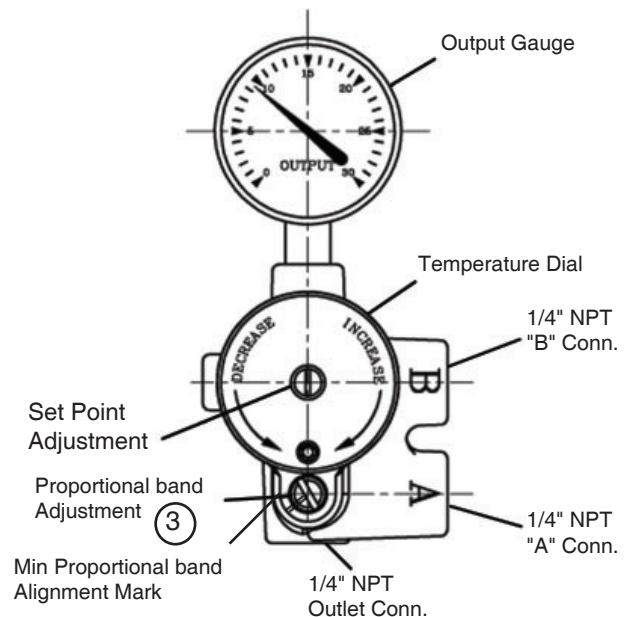


Figure 8: Front View

9. Rotate needle valve (3) CCW approximately 1/4 of a full revolution; this corresponds to approximately 6% PB.

NOTE: The needle valve (3) may be adjusted only 1-1/2 revolutions CCW from the initial 3% PB minimum value until the maximum 20% PB is reached. Do not rotate needle valve (3) beyond the 1-1/2" revolution limit.

10. By observing the output SIG of the 764T as indicated on instrument gauge (11), and manually varying control valve bypass flow upwards and downwards, the setpoint can be confirmed as approximately the point where output SIG pressure is at 9 psig (0.62 Barg).
11. Increase or decrease 764T setpoint to drive the control valve closed. Remember the ΔT change adjusted.
12. Open the block valves isolating the control valve.
13. Begin to manually close the control valve bypass valve while simultaneously changing the 764T setpoint back towards the desired setpoint prior to Article 11, this section. Attempt to simultaneously change the setpoint and further close the bypass in proportional increments; i.e. close the bypass about 10% while changing the setpoint by about 10% of the ΔT change of Article 11.

have sizeable time constants; i.e. flywheel effect. Make adjustments in small increments and wait for the results to stabilize.

14. If the control valve and 764T becomes unstable, leave the setpoint adjustment as is and increase PB adjustment by rotating needle valve (3) approximately 1/8 revolution CCW. Wait for results to stabilize.
15. Continue Articles 13. and 14. slowly until the control valve bypass valve is fully closed, and the 764T controller is regulating flow.
16. It is recommended that an "upset" be imposed onto the system, and observe the capability of the controller to stabilize the upset. If instability results, PB should be increased in 1/8 CCW revolutions until stability is within the 764T's capability.

NOTE: Many temperature control system loops

SECTION V

V. MAINTENANCE

A. General:

1. Refer to Figure 10 for cutaway view of 764T temperature controller and Figure 6 for cutaway view of the high temperature thermal bulb with extension post (Opt. -63).
2. Maintenance procedures hereinafter are based on removal of the controller with the thermal bulb (12) as a unit from the thermal well (17) or piping system.
3. When removing the tubing to/from the controller, tag the tube utilized with either Port "A" or "B".
4. There is no maintenance performable to the thermal well (17) for the controller. If the thermal well (17) is corroded, a liquid pressure test may be performed at the following maximum pressure levels:
SST Thermal Well —9,300 psig (641 Barg)
Brass Thermal Well —1,500 psig (103 Barg)
5. There is no maintenance performable to the thermal bulb (12) portion of the controller. If the thermal bulb (12) is corroded, a liquid

pressure test may be performed at the following maximum pressure levels to assure pressure integrity.

SST Thermal Bulb — 9,300 psig (641 Barg)
Brass Thermal Bulb—1,500 psig (103 Barg)

6. Lightly grease all O-rings upon replacement with lithium grease; cloth wipe all excess grease.
7. Place thermal bulb (12) into a vise and grip on the hex surfaces of the thermal bulb assembly (12). Orient the pneumatic section upwards.

B. Pneumatic Circuit Overhaul:

1. Remove output pressure gauge (11) and test calibration. If gauge (11) is off ± 2 psi (± 0.14 Bar) , replace gauge (11).
2. Using channel lock pliers or similar tool, loosen knurled lock nut (16) by rotating CCW (viewed from front). Back lock nut (16) away from thermal bulb (12) until it is stopped by contact with the sensor housing (1). Keep track of the number of revolutions loosened for lock nut (16) in table below:

2. (cont.)

Number of revolutions lock nut is
"loosened" from thermal bulb: _____
Number of revolutions to remove housing
from thermal bulb: _____

3. Remove name plate (10) by removing screw (9).
4. Remove four sensor end plate screws (8).
5. Grasp sensor end plate (2.2) and withdraw vertically from housing (1). Lay sensor subassembly (see Figure 9) on work surface; take care to not lose sensor pin (2.4) in handling.
6. Hand-grasp housing (1) and rotate CCW (viewed from knob end) to removal. Keep track of the number of revolutions to removal in table of Step 2, previous. Take care not to invert and drop the sensor plate subassembly (15) from the housing (1) internals in handling.
7. Remove thermal bulb (12) from vise, taking care not to invert and drop Invar rod (13) (also extension post (14)) of the thermal bulb (12) and cause end damage to rod (13) (also post (14)). Examine bulb (12) interior for signs of leakage; recommend complete 764T replacement if leakage is discovered.
8. Holding the housing (1) in a vise, remove the sensor plate O-ring (6) using an awl-type tool, and discard. **DO NOT DAMAGE METAL SURFACES!**
9. Remove the housing (1) from the vise, invert housing (1) with hand covering knob-end to allow sensor plate subassembly (15) to drop/slide out of the housing (1); it may be necessary to push adapter (15.2) to remove the sensor plate subassembly (15).
10. Pick up sensor subassembly (2). Allow sensor pin (2.4) to be removed. Rotate sensor (2.1) CCW (viewed from sensor end) to removal. Keep track of the number of rotations to remove the sensor (2.1) from the adjusting screw (2.3) in the following table:

Number of revolutions to remove sensor
from adjusting screw: _____
Number of revolutions to remove sensor
end plate from adjusting screw: _____

11. Rotate sensor end plate (2.2) CCW (viewed from sensor end) to removal. Keep track of the number of rotations to remove the end plate (2.2) from the adjusting screw (2.3) in the table of Step 11.
 12. Remove three O-rings (5) from sensor (2.1).
 13. Pick up housing (1). Using a suitable screwdriver, rotate needle valve (3) CW until it seats. Keep track of the number of revolutions required to seat the needle valve (3) and record in table below:
- Number of revolutions required to seat the
needle valve: _____
14. Reverse the rotation of the needle valve (3) and fully remove. Remove needle valve O-ring (7).
 15. Solvent clean and air blow all internal parts.
 16. Install new O-rings on the needle valve (7), and three on sensor (5).
 17. Place thermal bulb (12) back into a vise. Insert Invar rod (13) (also extension post (14)) into thermal bulb (12).
 18. Re-assemble sensor subassembly (2) end plate (2.2), adjusting screw (2.3), and sensor (2.1) per the recorded number of revolutions of Step 10, this sub-section; this will give "preliminary" adjustment. See Figure 9 for "final" adjustment dimensions of the sensor subassembly (2). Rotate sensor (2.1) as required to the closest hole available to allow sensor pin (2.4) to be inserted; insert pin (2.4).

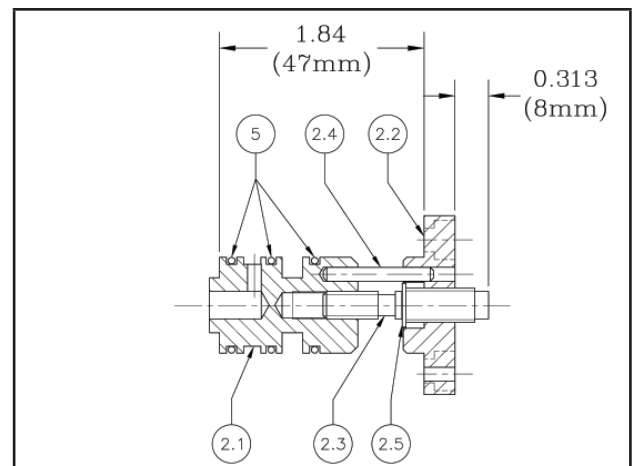


Figure 9: Sensor Sub-Assembly Dimensions

(NOTE: A temporary piece of tape may be used to cover the hole the pin is inserted into, to prevent the pin from becoming lost.)

19. Pick up housing (1) and insert sensor plate subassembly (15) back into the housing (1). Insert new sensor plate O-ring (6) up against the sensor plate (15.1).
20. Holding the housing (1) with the cavity upwards, re-insert sensor subassembly (2) into the housing (1) cavity. Push firmly until the sensor subassembly (2) end plate (2.2) reaches the mating face of the housing (1). **DO NOT FORCE INSERTION OF THE SENSOR SUBASSEMBLY (2). IF NOT CENTERED IN HOUSING (1) CAVITY, DAMAGE MAY OCCUR TO SENSOR O-RINGS (5)!**
21. Rotate sensor end plate (2.2) until the threaded hole for screw (9) is directly above the proportional band needle valve (3) opening. Holes should align for the four end plate screws (8); rotate as required. Insert screws (8) and fully tighten in a cross pattern.
22. (Remove temporary tape of Step 18 previous this sub-section.) Re-position name plate (10) onto sensor end plate (2.2) and align screw (9) hole; insert and tighten screw (9).
23. Insert housing (1) threaded end into thermal bulb (12), rotating the number of revolutions recorded in Step 2, this sub-section.
24. Rotate knurled locknut (16) the same number of revolutions recorded in Step 2, this sub-section. **NOTE:** *Lock nut (16) should be nearly/already tight; if lock nut (16) is not tight, fully tighten. If more/less than 1/2 revolution of the number recorded in Step 2 is required to tighten lock nut (16), it is recommended that the housing (1) be removed from the bulb (12) and that Steps 23 and 24 be repeated.*
25. Insert PB needle valve (3) into housing (1) and rotate CW until seated. Back out the needle valve (3) the number of revolutions recorded in table of Step 13, this sub-section.
26. Following the above procedure should bring the re-assembled unit "close" to the disassembled setpoint. Regardless, shop calibration is recommended.
27. Reinstall output pressure gauge (1) using suitable pipe thread compound or Teflon tape. **DO NOT APPLY EXCESS THREAD SEALANT!**

SECTION VI

VI. SHOP CALIBRATION

1. The Model 764T is a "blind controller"; i.e. non-indicating. When installed in the process each adjustment of the PB needle valve (3) and/or the adjusting screw (2.3) will affect the setpoint; i.e. the adjustments are inter-acting.
2. Install a 1/4" pipe plug in the "OUTPUT" port of the unit.
3. Provide an 18 psig (1.2 Barg) IAS to the proper port as determined by Table 1, Section II.
4. Leave PB as set in Section V.B.26.
5. Provide a known temperature bath that is equal to the desired setpoint temperature. The bath must be steady in its temperature.
6. Loosen knurled lock nut (16) 1-2 revolutions.
7. Insert the thermal bulb (12) such that it is immersed to the underneath side of the hex surface of the bulb (12). Place locking pliers on the hex surface of bulb (12) to hold firmly.
- 8.1. FOR DIRECT ACTION:
 - a. Rotate adjusting screw (2.3) CW or CCW to achieve desired set point. If set point cannot be achieved, go to step b or c.
 - b. If the output pressure gauge (11) is at 15 psig (1.03 Barg) or more, decrease the setpoint temperature by holding the thermal bulb (12) with locking pliers, and rotating housing (1) CW (viewed from front face) until the output pressure decreases to 9 psig (0.62 Barg).
 - c. If the output pressure gauge (11) is at 0 psig (0.0 Barg), increase the setpoint temperature by holding the thermal bulb (12) with locking pliers, and rotating housing (1) CCW (viewed from front face) until the output pressure increases to 9 psig (0.62 Barg).

- d. Using channel locking pliers, tighten knurled lock nut (16), to allow removal from the bath without the housing-to-thermal bulb joint changing with respect to each other.
- e. Place the thermal bulb into a vise and secure. Wrench tighten knurled lock nut (16) without allowing the housing (1) to "move".
- f. Re-insert the bulb (12) into the bath, and rotate adjusting screw (2.3) CW or CCW a few degrees to cause the calibration setpoint to be repeated. If setpoint is in error, repeat Sub-Steps a. through f. until correct.

8.2. FOR REVERSE ACTION:

- a. Rotate adjusting screw (2.3) CW or CCW to achieve desired set point. If set point cannot be achieved, go to step b or c.
- b. If the output pressure gauge (11) is at 15 psig (1.03 Barg) or more, increase the setpoint temperature by holding the thermal bulb (12) locking pliers, and rotating housing (1) CCW (viewed from front face) until the output pressure decreases to 9 psig (0.62 Barg).

- c. If the output pressure gauge (11) is at 0 psig (0.0 Barg), decrease the setpoint temperature by holding the thermal bulb (12) locking pliers, and rotating housing (1) CW (viewed from front face) until the output pressure increases to 9 psig (0.62 Barg).
- d. Using channel locking pliers, tighten knurled lock nut (16), to allow removal from the bath without the housing-to-thermal bulb joint changing with respect to each other.
- e. Place the thermal bulb into a vise and secure. Wrench-tighten knurled lock nut (16) without allowing the housing (1) to "move".
- f. Re-insert the bulb (12) into the bath, and rotate adjusting screw (2.3) CW or CCW a few degrees to cause the calibration setpoint to be repeated. If setpoint is in error, repeat Sub-Steps a. through f. until correct.

- 9. Remove plug of Step 2, and temporary IAS of Step 3.

SECTION VII

VII. TROUBLE SHOOTING GUIDE

- 1. No controller response.

Possible Cause	Remedy
A. Sensing thermal bulb loose at screwed connection to housing.	A. See remedy 5.A this section. Re-calibrate.
B. No air supply	B1. Check to see if air is available at airset. B2. Check to see if airset filter and/or drip-well is plugged.
C. Improper action; port "A" or "B" connections reversed.	C. Reference Tables 1 & 2 herein for desired action and proper port; reverse as required.
D. PB needle valve is fully closed.	D. Open at least to alignment of match-marks on valve's screw head and housing.
E. Ice formation.	E. Use dry air as an IAS medium in cold weather. Thaw as necessary by use of air heater. Trace as necessary.
F. Adjusting Screw is outside of operating window.	F. Reset Adjusting Screw length to be 5/16" out from nameplate.
G. Final element operation problem; i.e. control valve, positioner, solenoid, etc.	G. Reference instructions for operation of final element.

- 2. Improper control valve action.

Possible Cause	Remedy
A. Mismatch of pneumatic hardware.	A. Check bench set of actuator. Consider positioner or booster.
B. Improper action; port "A" or "B" connections are reversed.	B. Reference Tables 1 and 2 herein for desired action and proper port; reverse as required.

3. Erratic operation; rapid cycling.

Possible Cause	Remedy
A. Insufficient PB.	A. Increase PB in 1/8 rev. increments by turning the needle valve CCW. Reset set point as required (Max PB at 1-1/2 revs.)
B. Improper air supply.	B1. Supply pressure too high. Reduce airset output supply pressure to 15-18 psig. B2. Air supply unsteady. Replace airset.
C. Pulsing process.	C1. Poor location of process temperature tap. Evaluate and consider relocation. C2. Steady process, if possible.
D. Non-correctable process dynamics.	D1. Bypass control valve positioner and directly load actuator. D2. Review sizing and characteristic of control valve, may be oversized. Use restricted trim, if necessary. D3. Consult factory.

4. Sluggish operation; slow action.

Possible Cause	Remedy
A. Restricted flow(s)	A1. Disconnect tubing and blow sensing line. A2. Check equivalent output tubing line length against those indicated herein in Section II.1.c. Relocate controller, or consider adding an air booster or positioner at the control valve. A3. Check for mashed or pinched tubing. A4. Installation debris. Air-blow lines. A5. Ice in lines. Use dry air supply.
B. Insufficient air supply.	B. Increase supply up to 18-20 psig.
C. Too much PB.	C. Decrease PB in 1/8 rev. increments. Reset set point as required.
D. Poor sensing location of thermal bulb.	D1. Delete thermal well, if possible. Pack void space between bulb and well with heat transfer medium. D2. Evaluate and consider relocation.
E. Too large actuator.	E. Add on air booster or positioner at the actuator.
F. Use of alcohols, glycols in freezing weather; dissolved lubricant on o-rings	F. Remove sensor sub-assembly and lubricate rings.

5. Calibration erratic; frequent setpoint adjustments.

Possible Cause	Remedy
A. Sensing thermal bulb loose at screwed connection to housing.	A. Piping weight is cantilevered off of instrument air connections causing unscrewing, and effecting internal clearances. Change piping or add supports as required. Recalibrate.
B. Air supply debris.	B1. Provide a cleaner air supply or piping source. B2. Ice in lines. Correct as necessary.

6. Leakage of process fluid.

Possible Cause	Remedy
A. Thermal bulb and/or thermal well failure.	A1. Chemical attack. Consult factory. A2. Severe over-temperature. Replace unit.

7. Cannot reach upper or lower temperature levels of stated range.

Possible Cause	Remedy
A. Improper sensor sub-assembly setting.	A. Remove sensor sub-assembly. Check dimension to those indicated in Figure 9. If dimension is correct, and high setting cannot be reached, decrease dim "X" by rotating sensor end plate 1/2 revolution CW; reverse for lower setting.

SECTION VIII

VI. ORDERING INFORMATION NEW REPLACEMENT UNIT vs PARTS "KIT" FOR FIELD REPAIR

To obtain a quotation or place an order, please retrieve the Serial Number and Product Code that was stamped on the metal name plate and attached to the unit. This information can also be found on the Bill of Material ("BOM"), a parts list that was provided when unit was originally shipped.) (Serial Number typically 6 digits). Product Code typical format as follows: (last digit is alpha character that reflects revision level for the product).

□□□□-□□□□7-□□□□□□□□□□

NEW REPLACEMENT UNIT:

Contact your local Cashco Sales Representative with the Serial Number and Product code. With this information they can provide a quotation for a new unit including a complete description, price and availability.



CAUTION

Do not attempt to alter the original construction of any unit without assistance and approval from the factory. All purposed changes will require a new name plate with appropriate ratings and new product code to accommodate the recommended part(s) changes.

PARTS "KIT" for FIELD REPAIR:

Contact your local Cashco Sales Representative with the Serial Number and Product code. Identify the parts and the quantity required to repair the unit from the "BOM" sheet that was provided when unit was originally shipped.

NOTE: *Those part numbers that have a quantity indicated under "Spare Parts" in column "A" reflect minimum parts required for inspection and rebuild, - "Soft Goods Kit". Those in column "B" include minimum trim replacement parts needed plus those "Soft Goods" parts from column "A".*

If the "BOM" is not available, refer to the cross-sectional drawings included in this manual for part identification and selection.

A Local Sales Representative will provide quotation for appropriate Kit Number, Price and Availability.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. We reserve the right to modify or improve the designs or specifications of such product at any time without notice. Cashco does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Cashco product remains solely with the purchaser.

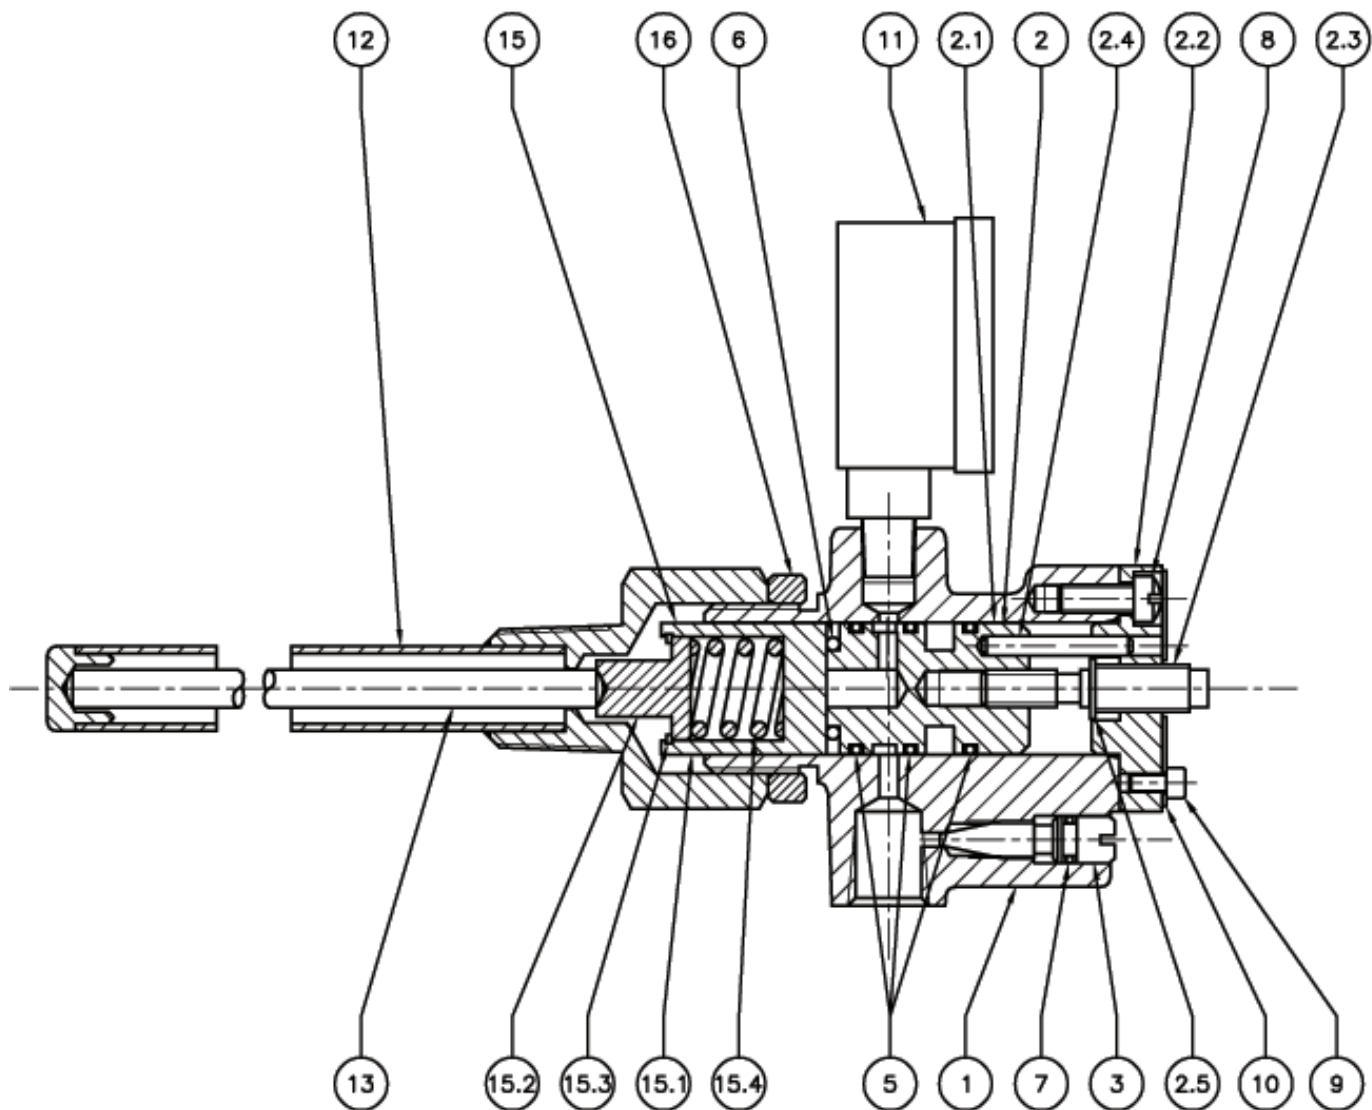


Figure 10

NOTE: High Temperature Thermal Bulb (Opt-63) sectional drawing and item number callouts may be found on page 4. Figure 6.

Item No.	Description	Item No.	Description
1	Housing	12	Thermal Bulb Assembly
2	Sensor Subassembly	13	Sensing Rod
2.1	Sensor *	15	Sensor Plate Subassembly
2.2	End Plate *	15.1	Sensor Plate
2.3	Adjusting Screw *	15.2	Adaptor
2.4	Sensor Pin *	15.3	Retaining Ring
2.5	Retaining Clip *	15.4	Spring
3	Needle Valve	16	Lock Nut
5	O-ring - Sensor		
6	O-ring - Sensor Plate		
7	O-ring - Needle Valve		
8	End Plate Screw		
9	Name Plate Screw		
10	Name Plate		
11	Gauge		

Not Shown:

17 Thermal Well

*** Not Sold as individual parts.
(Purchase Sensor Sub-Assembly 2)**



IOM ADDENDUM:

ATEX DIRECTIVE 2014/34/EU and THE EQUIPMENT AND PROTECTIVE SYSTEMS INTENDED FOR USE IN POTENTIALLY EXPLOSIVE ATMOSPHERES REGULATIONS 2016

Cashco declares that the products listed in the table below has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II of the ATEX Directive 2014/34/EU and given in Schedule 1 of The Equipment and Protective Systems Indented for Use in Potentially Explosive Atmospheres Regulations 2016. Compliance with the Essential Health and Safety Requirements has been assured by compliance with EN ISO 80079-36:2016 and EN ISO 80079-37:2016. The product will be marked as follows:



The 'X' placed after the technical file number indicates that the product is subject to specific conditions of use as follows:

1. The maximum surface temperature depends entirely on the operating conditions and not the equipment itself. The combination of the maximum ambient and the maximum process medium temperature shall be used to determine the maximum surface temperature and corresponding temperature classification, considering the safety margins described prescribed in EN ISO 80079-36:2016, Clause 8.2. Additionally, the system designer and users must take precautions to prevent rapid system pressurization which may raise the surface temperature of system components and tubing due to adiabatic compression of the system gas. Furthermore, the Joule-Thomson effect may cause process gases to rise in temperature as they expand going through a regulator. This could raise the external surface temperature of the regulator body and the downstream piping creating a potential source of ignition. Whether the Joule-Thomson effect leads to heating or cooling of the process gas depends on the process gas and the inlet and outlet pressures. The system designer is responsible for determining whether the process gas temperature may raise under any operating conditions.
2. Where the process medium is a liquid or semi-solid material with a surface resistance in excess of 1GΩ, special precautions shall be taken to ensure the process does not generate electrostatic discharge.
3. Special consideration shall be made regarding the filtration of the process medium if there is a potential for the process medium to contain solid particles. Where particles are present, the process flow shall be <1m/s (<3.3 ft/s) in order to prevent friction between the process medium and internal surfaces.
4. Effective earthing (grounding) of the product shall be ensured during installation.
5. The valve body/housing shall be regularly cleaned to prevent build up of dust deposits.
6. Regulators must be ordered with the non-relieving option (instead of the self-relieving option) if the process gas they are to be used with is hazardous (flammable, toxic, etc.). The self-relieving option vents process gas through the regulator cap directly into the atmosphere while the non-relieving option does not. Using regulators with the self-relieving option in a flammable gas system could create an explosive atmosphere in the vicinity of the regulator.
7. Tied diaphragm regulators with outlet ranges greater than 7 barg (100 psig) should be preset to minimize the risk that improper operation might lead to an outboard leak and a potentially explosive atmosphere.
8. All equipment must only be fitted with manufacturer's original spare parts.
9. Ensure that only non-sparking tools are used, as per EN 1127-1, Annex A.

	PRODUCT
	31-B, 31-N
	1164, 1164(OPT-45)
	1171, 1171(OPT-45), 1171(CRYO)
	2171, 2171(OPT-45), 2171(CRYO), 3171
	1465, 3381, 3381(OPT-45), 3381(OPT-40)
	4381, 4381(OPT-37), 4381(CRYO), 4381(OPT-45), 5381
	MPRV-H, MPRV-L
	PBE, PBE-L, PBE-H
	CA-1, CA-2
	CA1, SA1, CA4, SA4, CA5, SA5
	DA2, DA4, DA5, DA6, DA8
	DA0, DA1, DAP, SAP
	SLR-1, SLR-2, PTR-1
	ALR-1, ULR-1, PGR-1
	BQ, BQ(OPT-45), BQ(CRYO)
	123, 123(CRYO), 123(OPT-45), 123(OPT-46G)
	123-1+6, 123-1+6(OPT-45), 123-1+6(OPT-46G), 123-1+6+S, 123-1+6+S(OPT-40)
	1000HP, 1000HP(OPT-37), 1000HP(OPT-45), 1000HP(OPT-45G), 1000HP(CRYO)
	1000HP-1+6, 1000HP-1+8, 1000LP, 1000LP(OPT-45), 1000LP(OPT-46G)
	6987
	8310HP, 8310HP-1+6, 8310HP-1+8, 8310LP, 8311HP, 8311LP
	345, 345(OPT-45)
	BA1/BL1, PA1/PL1
	C-BPV, C-PRV, C-CS
	D, D(CRYO), D(OPT-37), D(OPT-20), D(OPT-45)
	DL, DL(LCC), DL(OPT-45)
	BR, BR(CRYO)
	HP, HP(LCC), HP(OPT-45), HP(OPT46G), HP-1+6+S(OPT-40), HP-1+6+S
	P1, P2, P3, P4, P5, P7
	B2, B7
	POSR-1, POSR-2
	5200P, 5300P
	135
	NW-PL, NW-SO
	CG-PILOT
	FG1
REGULATORS	
CONTROL VALVES	RANGER, 987, PREMIER
	964, 521, 988, 988-MB, 989
	2296/2296HF
	SCV-30, SCV-S
TANK BLANKETING	8700, 8910, 8920, 8930, 8940
	2100, 2199
	3100, 3200, 3300, 3400, 3500, 3600, 3700
	1078, 1088, 1100, 1049
	5100, 5200, 5400, 5500
	4100, 4200, 4300, 4400, 4500, 4600
MISC	764P/PD, 764-37, 764T

Cashco
P.O. Box 6
Ellsworth, KS 67439-0006
PH (785) 472-4461
Fax. # (785) 472-3539
www.cashco.com
email: sales@cashco.com
Printed in U.S.A. 764T-IOM

Cashco GmbH
Handwerkerstrasse 15
15366 Hoppegarten, Germany
PH +49 3342 30968 0
Fax. No. +49 3342 30968 29
www.cashco.com
email: germany@cashco.com

Cashco do Brasil, Ltda.
Al.Venus, 340
Indaiatuba - Sao Paulo, Brazil
PH +55 11 99677 7177
Fax. No.
www.cashco.com
email: brazil@cashco.com